

TEST REPORT



E-mail: info@janoshik.com

Web: www.janoshik.com

Task Number [REDACTED]

Testing ordered > 28 JUN '26

Sample received > 07 JUL '26

Client [REDACTED]

Sample KLOW 80mg

Manufacturer [REDACTED]

Batch PMQA

Sample description >

See picture or pictures attached.

Tests requested >

KLOW (GHK or GHK-Cu/ TB-500/ BPC-157/ KPV) analysis – ID and amount; peptide purity not included

Results >



KPV	11.61 mg; 12.01 mg; 11.74 mg.
TB-500 (TB4)	10.57 mg; 10.69 mg; 10.67 mg.
BPC-157	11.36 mg; 11.70 mg; 11.47 mg.

Comments >


GHK-Cu (GHK content) [Copper content]: 54.66 mg (48.29 mg) [6.37 mg];
GHK-Cu (GHK content) [Copper content]: 56.11 mg (49.35 mg) [6.76 mg];
GHK-Cu (GHK content) [Copper content]: 55.32 mg (48.92 mg) [6.40 mg];

Analysis conducted > 21 JUL 2026

Signature >

Verify this test at www.janoshik.com/verify/ with the following unique key

FJ0A4N1L2D

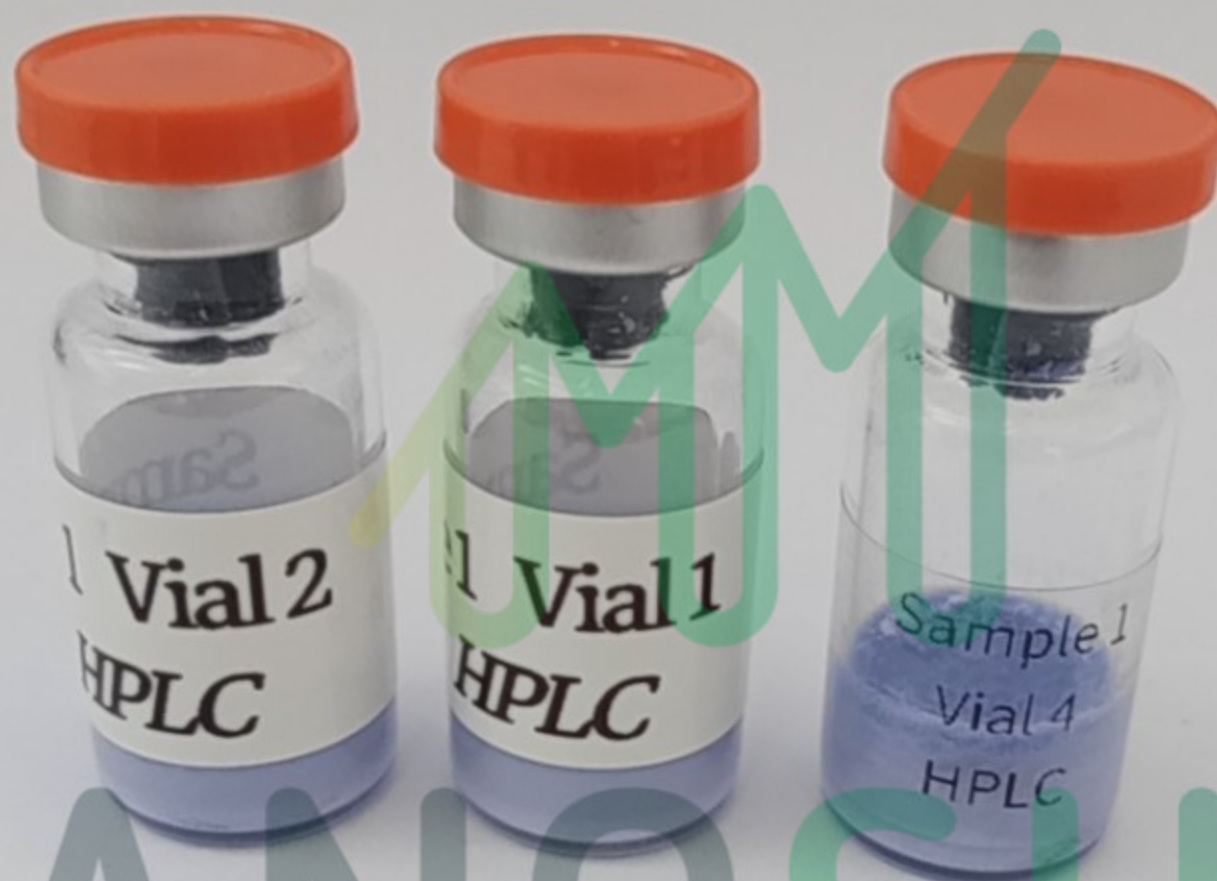

JANOSHIK